



NEW WATER MAIN

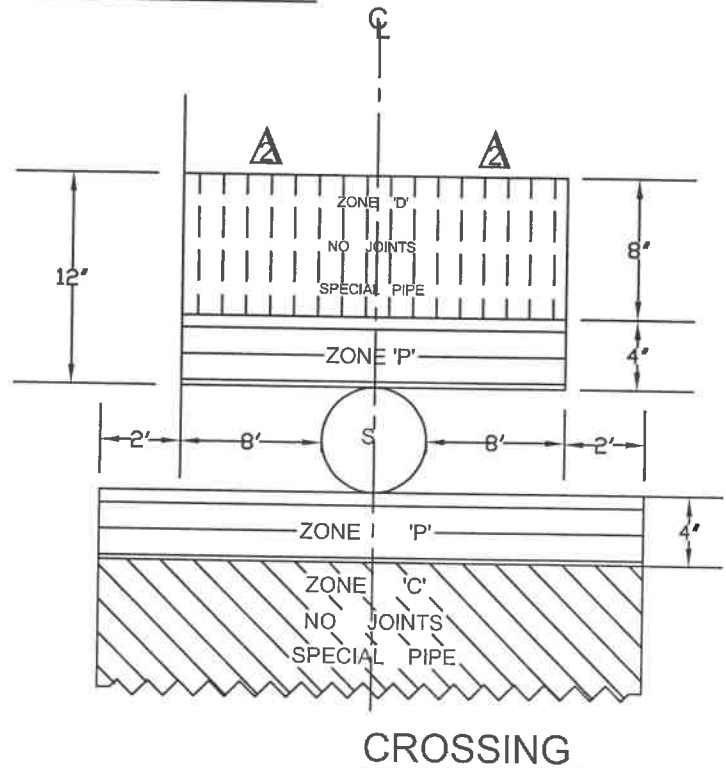

NOTES :

1. ZONE 'P' IS A PROHIBITED ZONE PER SECTION 64630 (e) (2) CALIFORNIA ADMINISTRATIVE CODE, TITLE 22.
2. ZONE 'A' IS A NO CONSTRUCTION ZONE WITHOUT APPROVAL FROM RESPONSIBLE HEALTH AGENCY AND WATER SUPPLIER.
3. ZONE 'B': NEW WATER MAIN WILL BE CONSTRUCTED OF :
A. DUCTILE IRON PIPE, CLASS 52, CEMENT MORTAR LINED WITH COMPRESSION JOINTS.
4. ZONE 'C': NEW WATER MAIN WILL BE CONSTRUCTED OF DUCTILE IRON PIPE, CLASS 52, WITH HOT DIP BITUMINOUS COATING, CEMENT MORTAR LINING.
5. ZONE 'D': NEW WATER MAIN WILL BE CONSTRUCTED OF DUCTILE IRON PIPE, CLASS 52, WITH HOT DIP BITUMINOUS COATING, CEMENT MORTAR LINING.
6. CRITERIA ALSO APPLIES TO WATER MAINS THAT CROSS BELOW A SEWER LATERAL BUT NOT THOSE THAT CROSS ABOVE.
7. PIPE, COATING AND LINING SHALL BE PER A.W.W.A. STANDARD SPECIFICATIONS.

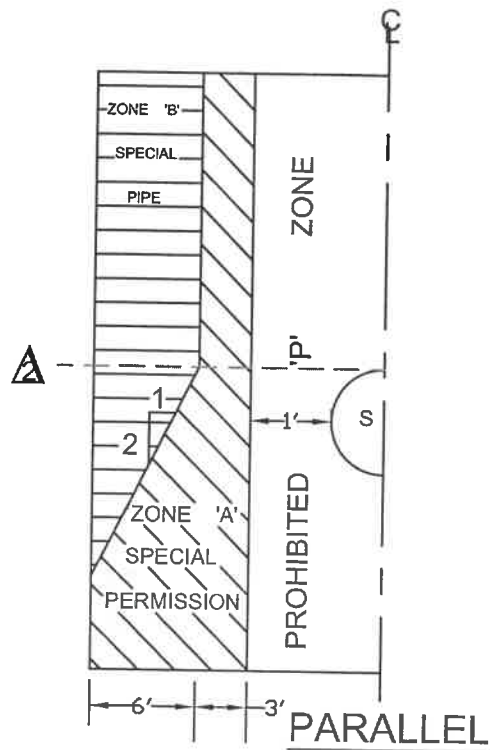

PUBLIC WORKS SERVICES

WATER MAIN AND SEWER SEPARATION REQUIREMENTS

APPROVED:

CITY OF ARCADIA—PUBLIC WORKS SERVICES DIRECTOR

DATE

APPROVED:

CITY OF ARCADIA — CITY ENGINEER

39871

RCE No.

DATE

REVISIONS: DATE REVISIONS: DATE

03/19/03

12/29/06

SCALE: NOT TO SCALE

STANDARD PLAN NUMBER

701

SHEET 1 OF 1