



INSTALL HOSE BIB
W/ ATMOSPHERIC
VACUUM BREAKER

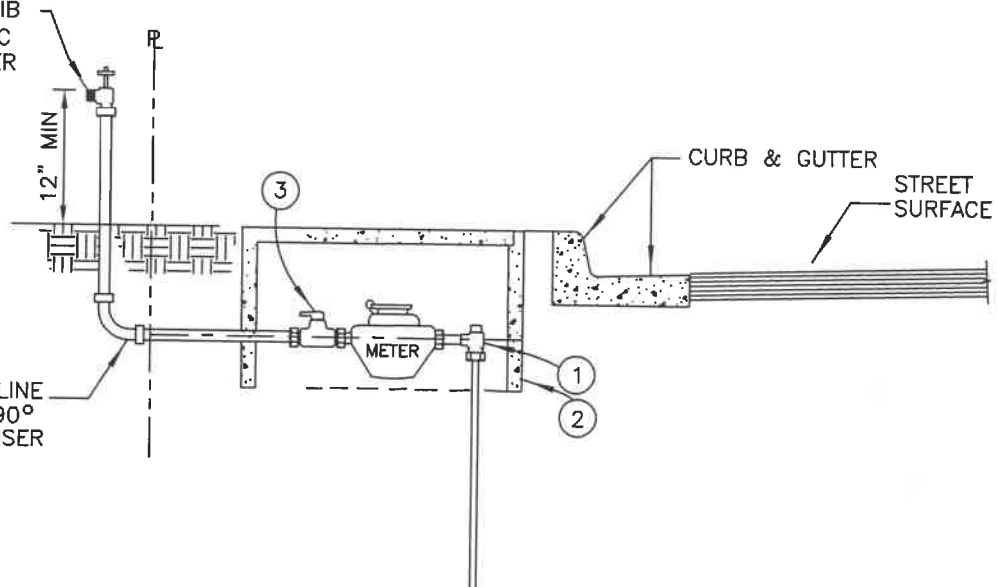

STANDPIPE INSTALLATION - NO SIDEWALK

INSTALL HOSE BIB
W/ ATMOSPHERIC
VACUUM BREAKER

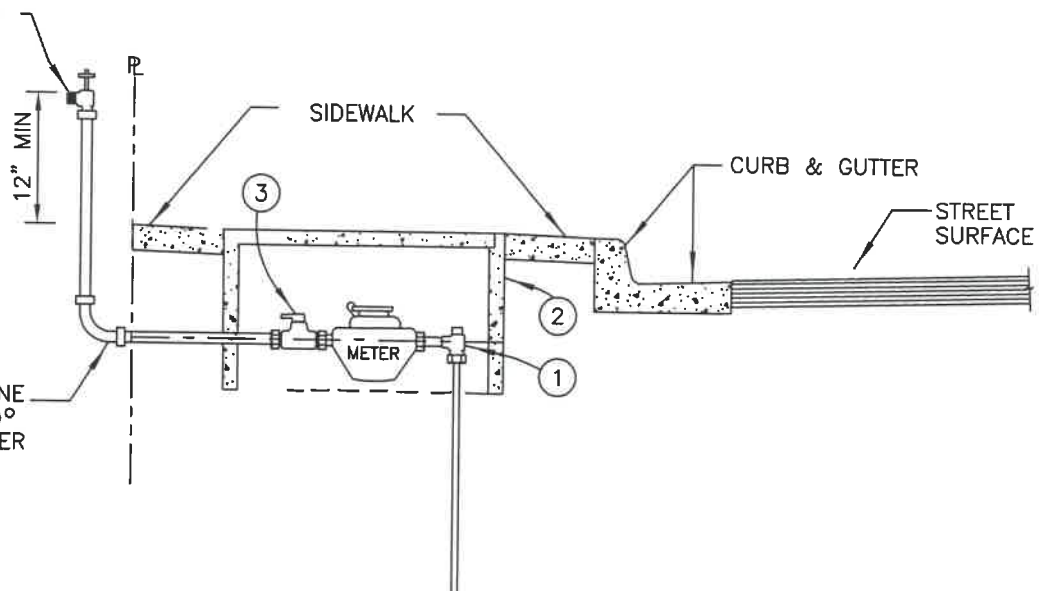

STANDPIPE INSTALLATION - ADJACENT SIDEWALK

ITEM	DESCRIPTION	MANUFACTURER OR EQUAL
①	ANGLE METER STOP - BALL VALVE W/ LOCK WING & PACK JOINT FOR COPPER	FORD FB 1000, 2" OR JONES J1937, 2"
②	METER BOXES (SUPPLIED BY THE CITY AT DEVELOPER'S COST).	
③	2" OR 1-1/2" BRASS BALL VALVE W/ HANDLE.	FORD, JONES, MUELLER



PUBLIC WORKS SERVICES

CONSTRUCTION - DEMOLITION STANDPIPE INSTALLATION

APPROVED:

CITY OF ARCADIA - PUBLIC WORKS SERVICES DIRECTOR

DATE

APPROVED:

CITY OF ARCADIA - CITY ENGINEER

39871

RCE No.

DATE

REVISIONS:	DATE	REVISIONS:	DATE
⚠	12/28/06	⚠	
⚠		⚠	

SCALE: NOT TO SCALE

STANDARD PLAN NUMBER

711

SHEET 1 of 1