




NOTES:

1. ALL BACKFLOW PREVENTION DEVICES SHALL BE APPROVED BY THE FOUNDATION FOR CROSS-CONNECTION CONTROL AND HYDRAULIC RESEARCH AT THE UNIVERSITY OF SOUTHERN CALIFORNIA.
2. BACKFLOW PREVENTERS SHALL BE LOCATED AS CLOSE AS POSSIBLE TO THE METER AND NO CONNECTIONS SHALL BE MADE BETWEEN THE METER AND BACKFLOW PREVENTER.
3. WHEN INSTALLATION IS NEAR A BUILDING OR WALL, THE BACKFLOW PREVENTER SHALL BE ACCESSIBLE FOR TESTING, MAINTENANCE, REPAIR OR REPLACEMENT.
4. PIPING MATERIALS SHALL BE APPROVED BY THE PUBLIC WORKS SERVICES DEPARTMENT.
5. THE INSTALLATION WILL BE INSPECTED BY THE CITY BACKFLOW INSPECTOR PRIOR TO BEING PLACED IN SERVICE.
6. BACKFLOW PREVENTERS SHALL BE SCREENED FROM PUBLIC VIEW AS REQUIRED BY THE CITY PLANNING DEPARTMENT.

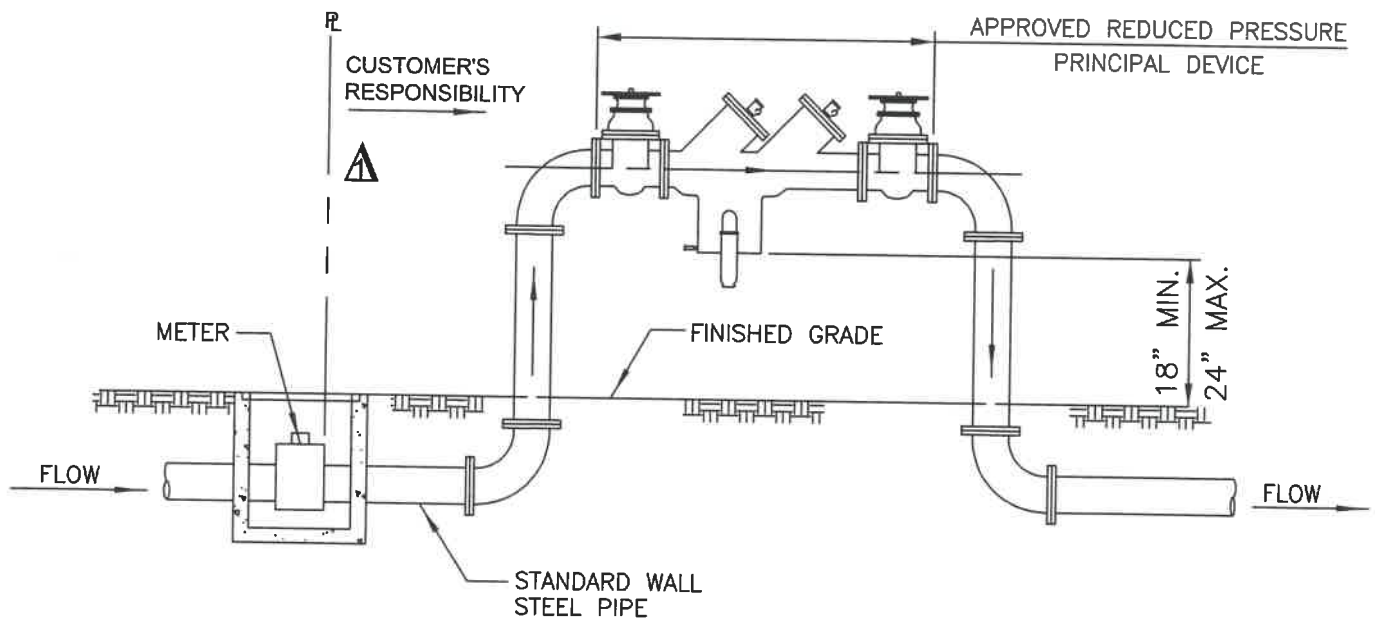

PUBLIC WORKS SERVICES

BACKFLOW PREVENTION DEVICE REDUCED PRESSURE PRINCIPLE

APPROVED: *[Signature]* 6/3/2020
CITY OF ARCADIA-PUBLIC WORKS SERVICES DIRECTOR DATE

APPROVED: *[Signature]* 38971 6/03/20
CITY OF ARCADIA CITY ENGINEER RCE No. DATE

REVISIONS:	DATE	REVISIONS:	DATE
1	05/26/20	2	
3		4	
SCALE: NOT TO SCALE			
STANDARD PLAN NUMBER			
712			
SHEET 1 of 1			