




NOTES:

1. BACKFLOW PREVENTION DEVICES SHALL BE APPROVED BY THE FOUNDATION FOR CROSS-CONNECTION CONTROL AND HYDRAULIC RESEARCH AT THE UNIVERSITY OF SOUTHERN CALIFORNIA.
2. THE BYPASS METER ON THE DOUBLE CHECK DETECTOR ASSEMBLY SHALL REGISTER IN CUBIC FEET(C.F.).
3. WHEN INSTALLATION IS NEAR A BUILDING OR WALL, THE BACKFLOW PREVENTER SHALL BE ACCESSIBLE FOR TESTING, MAINTENANCE, REPAIR OR REPLACEMENT.
4. PIPING MATERIALS SHALL BE APPROVED BY THE PUBLIC WORKS SERVICES DEPARTMENT- WATER SECTION.
5. THE INSTALLATION WILL BE INSPECTED BY THE CITY BACKFLOW INSPECTOR PRIOR TO BEING PLACED IN SERVICE.
6. BACKFLOW PREVENTERS SHALL BE SCREENED FROM PUBLIC VIEW AS REQUIRED BY THE CITY PLANNING DEPARTMENT.
7. THE BACKFLOW PREVENTER SHALL BE PLACED AS CLOSE AS POSSIBLE TO THE CUSTOMER'S PROPERTY LINE, BUT NO CLOSER THAN 3 FEET, AND PARALLEL WITH THE PROPERTY LINE ADJACENT TO TO THE PUBLIC RIGHT OF WAY.

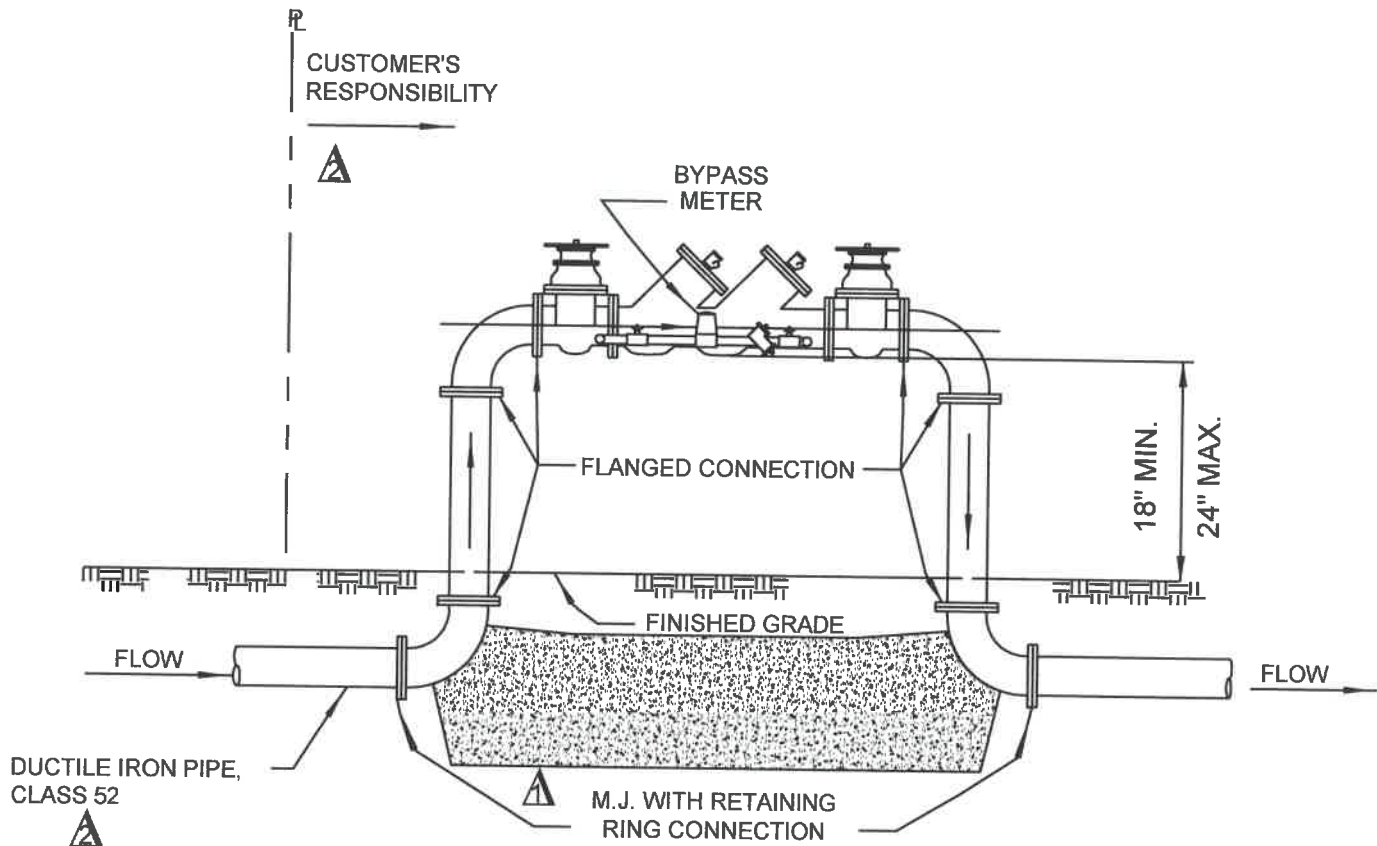

PUBLIC WORKS SERVICES

BACKFLOW PREVENTION DEVICE DOUBLE CHECK DETECTOR ASSEMBLY (HORIZONTAL INSTALLATION)

APPROVED:

CITY OF ARCADIA-PUBLIC WORKS SERVICES DIRECTOR

7/20/17
DATE

APPROVED:

CITY OF ARCADIA - CITY ENGINEER

38971

RCE No.

8-2-22
DATE

REVISIONS: DATE REVISIONS: DATE


1		2	
2	6/21/17	3	

SCALE: NOT TO SCALE

STANDARD PLAN NUMBER

714

SHEET 1 of 2

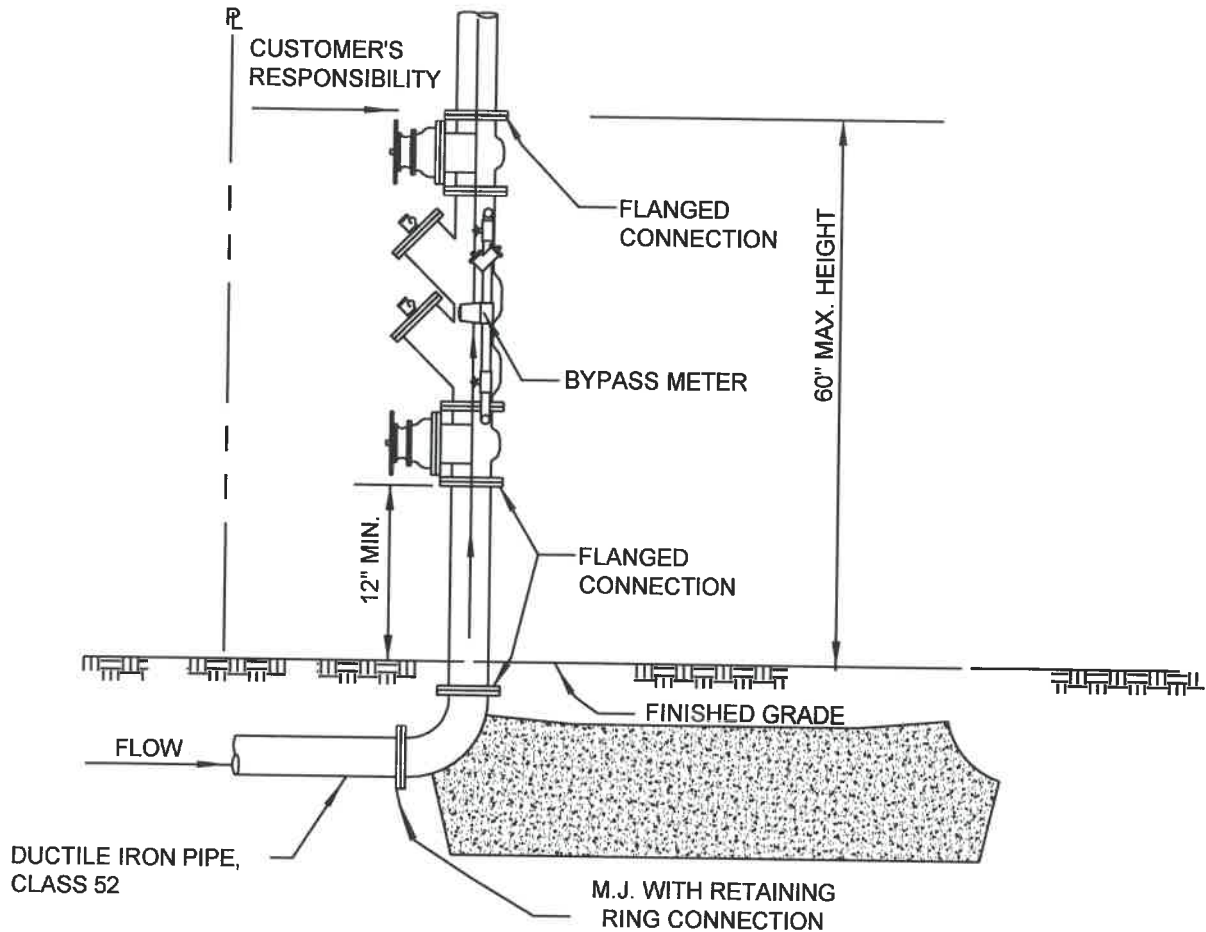

NOTES:

1. BACKFLOW PREVENTION DEVICES SHALL BE APPROVED BY THE FOUNDATION FOR CROSS-CONNECTION CONTROL AND HYDRAULIC RESEARCH AT THE UNIVERSITY OF SOUTHERN CALIFORNIA.
2. THE BYPASS METER ON THE DOUBLE CHECK DETECTOR ASSEMBLY SHALL REGISTER IN CUBIC FEET(C.F.).
3. WHEN INSTALLATION IS NEAR A BUILDING OR WALL, THE BACKFLOW PREVENTER SHALL BE ACCESSIBLE FOR TESTING, MAINTENANCE, REPAIR OR REPLACEMENT.
4. PIPING MATERIALS SHALL BE APPROVED BY THE PUBLIC WORKS SERVICES DEPARTMENT- WATER SECTION.
5. THE INSTALLATION WILL BE INSPECTED BY THE CITY BACKFLOW INSPECTOR PRIOR TO BEING PLACED IN SERVICE.
6. BACKFLOW PREVENTERS SHALL BE SCREENED FROM PUBLIC VIEW AS REQUIRED BY THE CITY PLANNING DEPARTMENT.
7. THE BACKFLOW PREVENTER SHALL BE PLACED AS CLOSE AS POSSIBLE TO THE CUSTOMER'S PROPERTY LINE, BUT NO CLOSER THAN 3 FEET, AND PARALLEL WITH THE PROPERTY LINE ADJACENT TO TO THE PUBLIC RIGHT OF WAY.



PUBLIC WORKS SERVICES

BACKFLOW PREVENTION DEVICE DOUBLE CHECK DETECTOR ASSEMBLY (VERTICAL INSTALLATION)

APPROVED:

CITY OF ARCADIA-PUBLIC WORKS SERVICES DIRECTOR

DATE

APPROVED:

CITY OF ARCADIA - CITY ENGINEER

38971

RCE No.

DATE

REVISIONS: DATE REVISIONS: DATE

Δ		Δ	
Δ		Δ	

SCALE: NOT TO SCALE

STANDARD PLAN NUMBER

714

SHEET 2 OF 2