


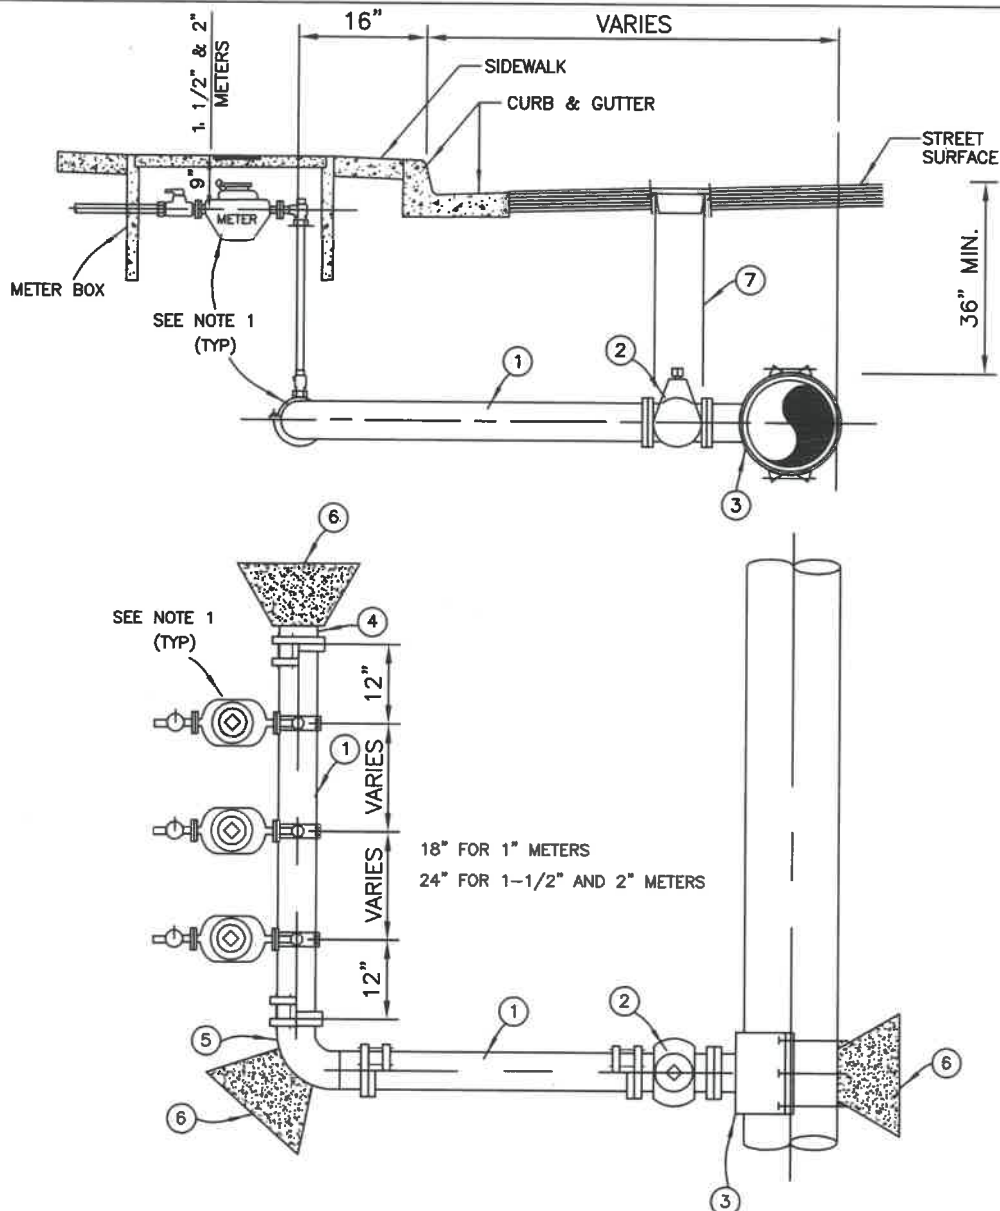

NOTES

1. ALL METER INSTALLATION SHALL BE INSTALLED IN ACCORDANCE WITH THE CITY OF ARCADIA STANDARD DRAWING 704.
2. MANIFOLD SIZE TOTAL FLOW REQUIRED

4"	0-390 GPM
6"	391-880 GPM
8"	881-1565 GPM

ITEM	DESCRIPTION	MANUFACTURER OR EQUAL
①	4", 6", OR 8" DUCTILE IRON PIPE (SEE NOTE 2)	CLASS 52
②	4", 6", OR 8" MJ (WITH RETAINER GLAND) X FE R/W GATE VALVE (SEE NOTE 2)	CLOW, KENNEDY, OR AMERICA FLOW CONTROL
③	(SIZE OF MAIN) X 4", 6", OR 8" MJ X FE TAPPING SLEEVE (SEE NOTE 2)	SMITH BLAIR, ROMAC, FORD, MUELLER
④	DUCTILE IRON CAP - FE OR MJ WITH RETAINER GLAND	
⑤	DUCTILE IRON 90 BEND - FE OR MJ WITH RETAINER GLAND	
⑥	THRUST BLOCK PER CITY STANDARD 710	
⑦	VALVE COVER ASSEMBLY PER CITY STANDARD 718	



PUBLIC WORKS SERVICES

1", 1-1/2" AND 2" MANIFOLD INSTALLATION OF METER

APPROVED: *Tam Tait* 4/9/11
CITY OF ARCADIA-PUBLIC WORKS SERVICES DIRECTOR DATE

APPROVED: *Phil W.* 4/05/11
CITY OF ARCADIA - CITY ENGINEER RCE No. 38971 DATE

REVISIONS:	DATE	REVISIONS:	DATE
△	3/29/11	△	
△		△	

SCALE: NOT TO SCALE

STANDARD PLAN NUMBER

715

SHEET 1 OF 1