


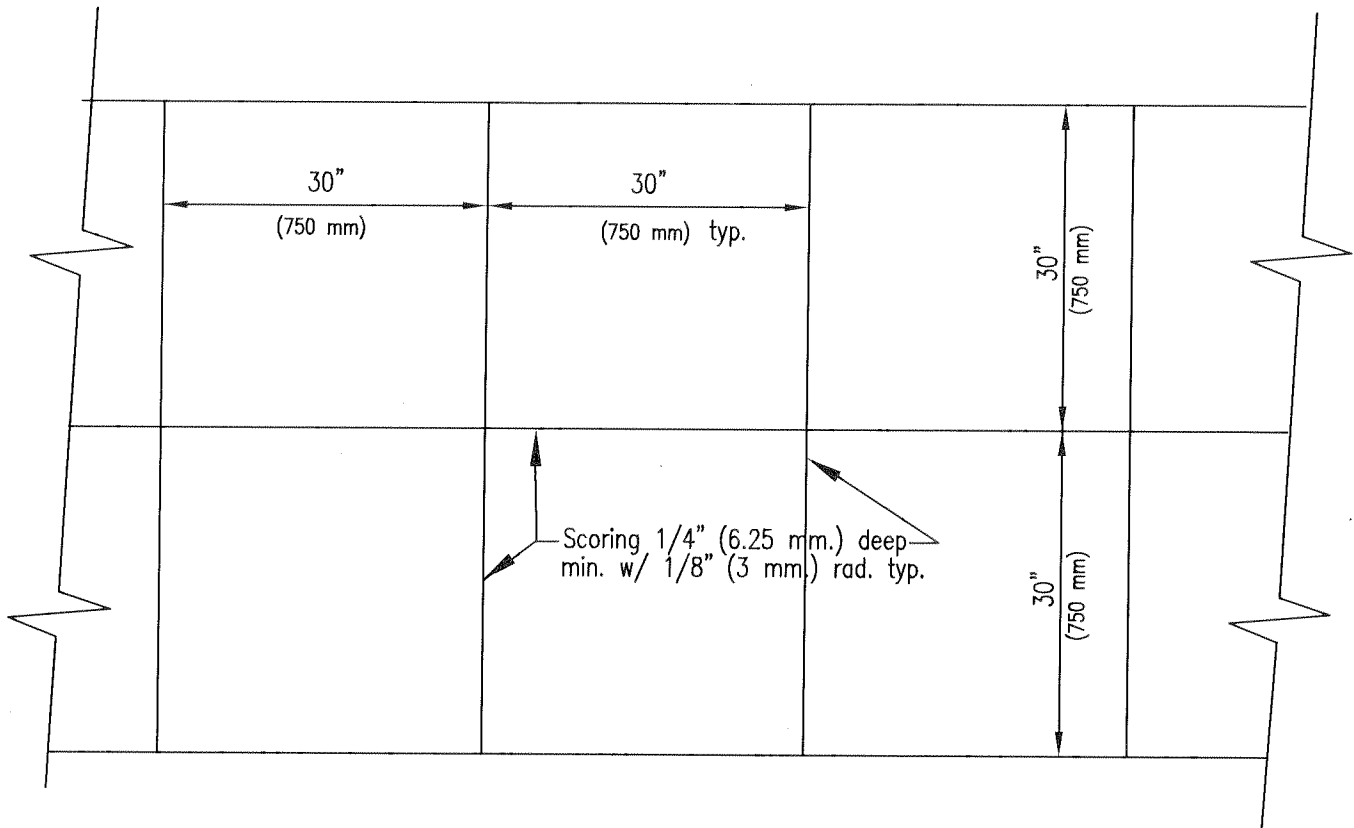


PLAN VIEW
NTS

Note:


Standard scoring for sidewalks will be 30" (750 mm.) both ways, except where existing is joined and then scoring will match existing. A 1/8" scoring tool will be used on all scoring, and a light broom finish will be required. 1/2" (12.5 mm.) expansion joint fillers will be placed every 20' (600 mm.). Concrete shall be class 520-C- 2500 (310-C-17). The thickness of sidewalk shall be full 4" (100 mm.) placed over 90% compacted subgrade. Sidewalk in commercial areas shall be full parkway width. Where standard 5' (1500 mm.) sidewalk is constructed adjacent to back of curb in returns and joins existing back of curb sidewalk on either side, scoring will be concentric to curb return.

STANDARD SIDEWALK SCORING

CITY OF ARCADIA
DEVELOPMENT SERVICES DEPT. - ENGINEERING DIV.

 CITY ENGINEER		38971 RCE
DATE:	SCALE:	DRAWN BY:
12/8/03	NONE	AG/JC

STANDARD DRAWING
802 - 1
SHEET 1 OF 1

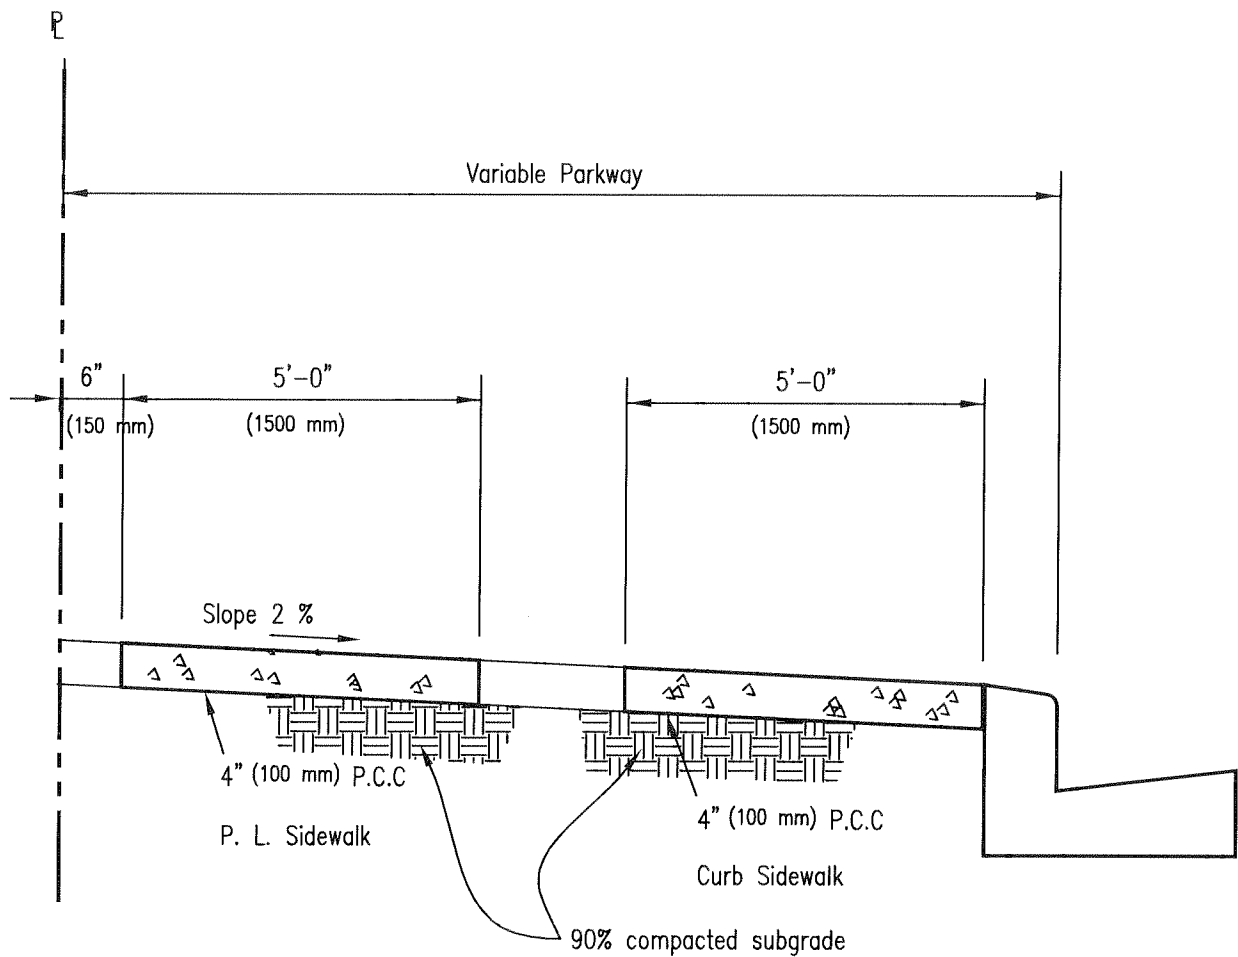

TYPICAL SIDEWALK DETAIL
NTS

TYPICAL RESIDENTIAL SIDEWALK DETAILS

CITY OF ARCADIA
DEVELOPMENT SERVICES DEPT. - ENGINEERING DIV.

DATE: 12/8/03

CITY ENGINEER

SCALE: NONE

38971


RCE

DRAWN BY: AG/JC


STANDARD DRAWING

802 - 2

SHEET 1 OF 1

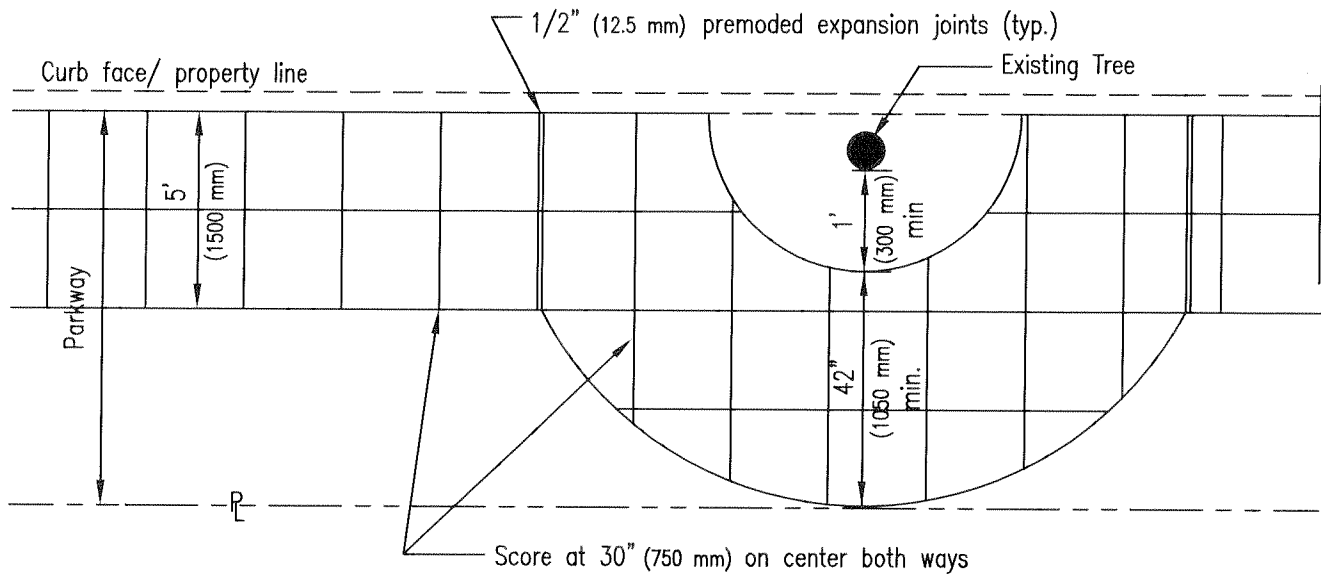

SIDEWALK PLAN AND CIRCUMVENTION OF TREES
NTS

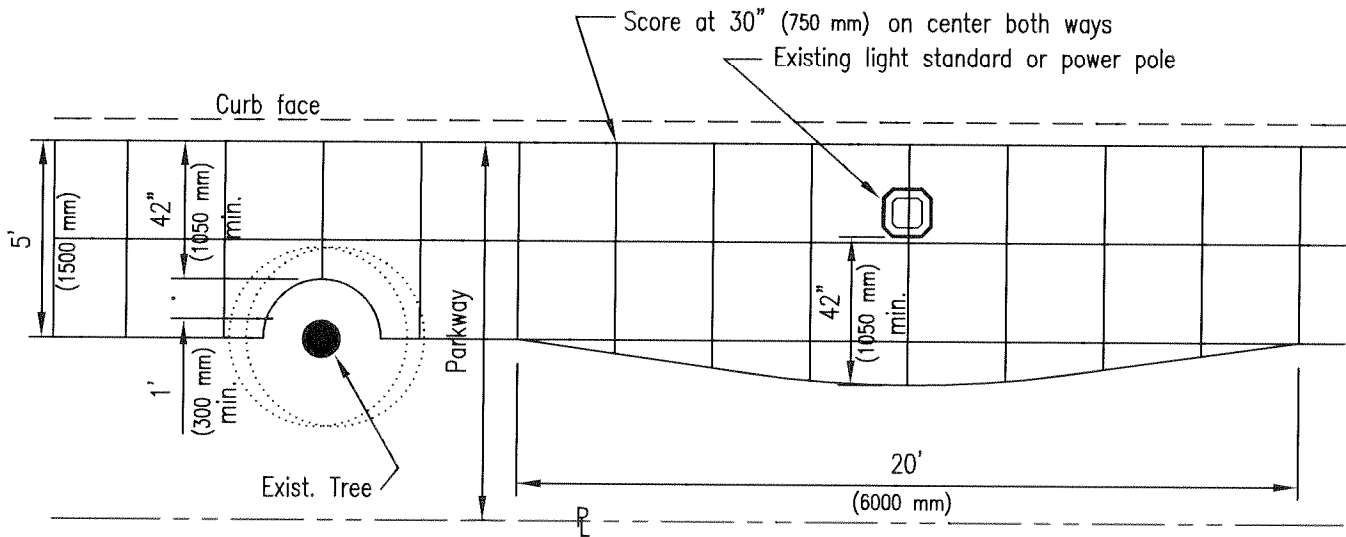

TREE WELL AND LIGHT STANDARD
NTS

**TYPICAL SIDEWALK
DETAILS**
(Circumvention)

CITY OF ARCADIA
DEVELOPMENT SERVICES DEPT. - ENGINEERING DIV.

Dr. J. W. Why
CITY ENGINEER
DATE: 12/8/03
SCALE: NONE
38971
RCE
DRAWN BY: AG/JC

STANDARD DRAWING
802 - 3
SHEET 1 OF 1