


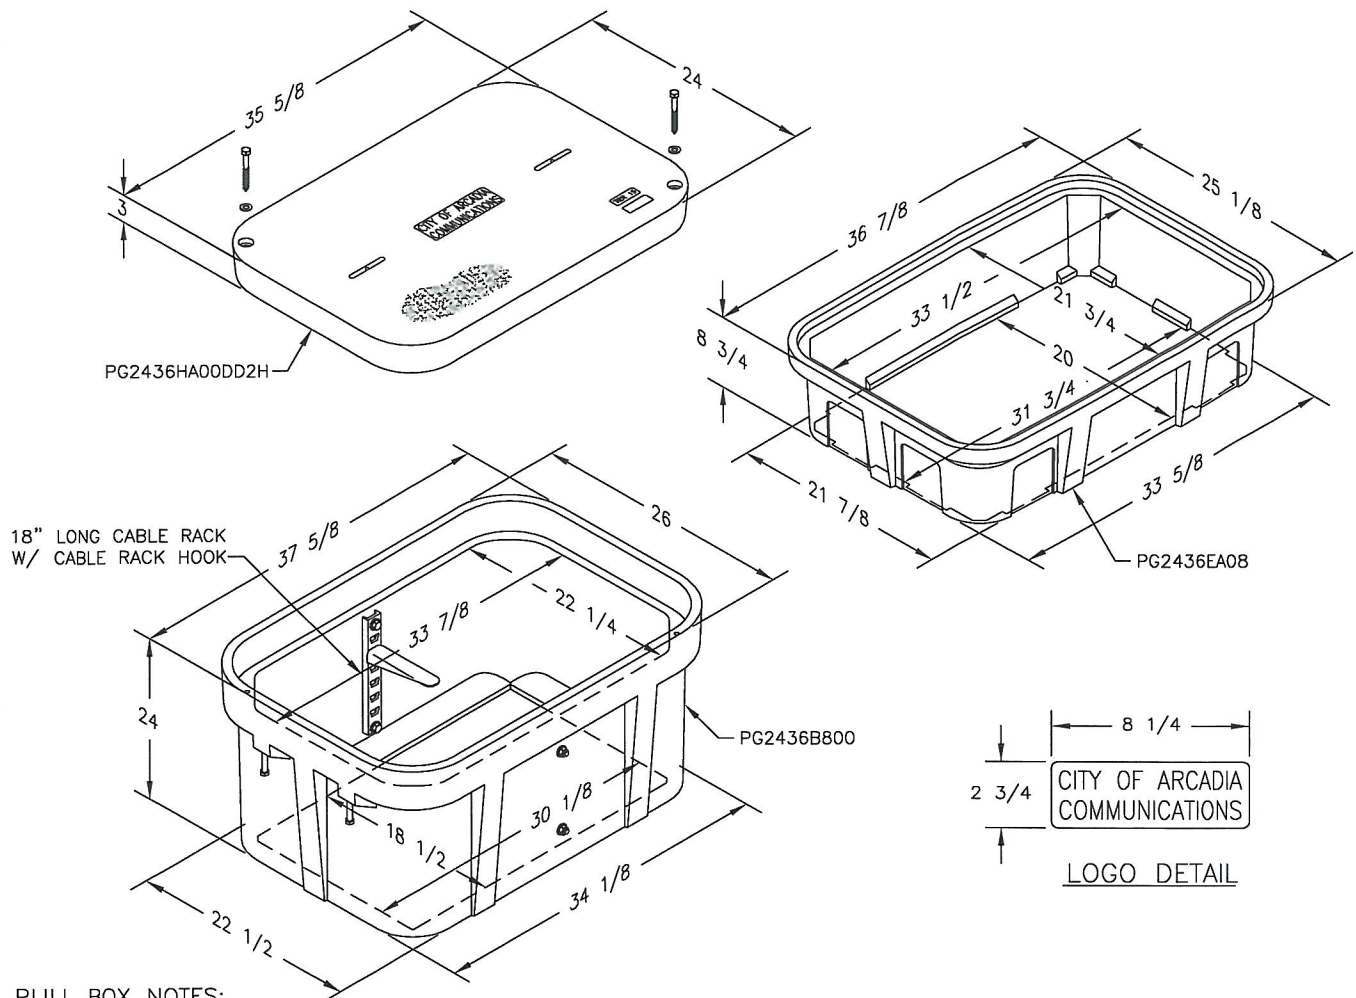

PULL BOX NOTES:

1. ALL NON-DELIBERATE TRAFFIC PULL BOX COVERS MUST COMPLY WITH ALL TEST PROVISIONS OF ANSI/SCTE 77 2010 "SPECIFICATION FOR UNDERGROUND ENCLOSURE INTEGRITY", AND MUST MEET THE TIER 15 APPLICATION. MARKINGS SHOWING THE TIER 15 RATING MUST BE EMBOSSED IN THE TOP SURFACE OF THE COVER.
2. ALL NON-DELIBERATE TRAFFIC PULL BOXES MUST COMPLY WITH ALL TEST PROVISIONS OF ANSI/SCTE 77 2010 "SPECIFICATION FOR UNDERGROUND ENCLOSURE INTEGRITY", AND MUST MEET THE TIER 22 APPLICATION. MARKINGS SHOWING THE TIER 22 RATING MUST BE LABELED OR STENCILED ON THE INSIDE AND OUTSIDE OF THE BOX.
3. ALL NON-DELIBERATE TRAFFIC PULL BOXES AND COVERS MUST BE MADE OF POLYMER CONCRETE WITH FIBERGLASS REINFORCEMENT. THE BOX MUST HAVE CONTINUOUS FIBERGLASS CLOTH REINFORCEMENT ON THE INSIDE AND OUTSIDE PERIMETERS. THE COVERS MUST HAVE A MINIMUM OF TWO LAYERS OF FIBERGLASS CLOTH REINFORCEMENT.
4. ALL NON-DELIBERATE TRAFFIC PULL BOXES AND COVERS MUST BE TESTED AND CERTIFIED, MEETING ALL TEST PROVISIONS OF THE ANSI/SCTE 77, BY UL (UNDERWRITERS LABORATORIES) TO THE 66WF, MEETING ALL TEST PROVISION OF THE LATEST REVISION OF ANSI/SCTE 77.
5. COVER MUST BE SECURED TO PULL BOX USING 3/8-7 LAG THREAD HEX HEAD BOLTS.
6. PULL SLOTS MUST BE RATED FOR A MINIMUM PULL OUT OF 3,000 POUNDS.
7. THE PULL BOX MUST INCLUDE TWO 18" CABLE RACKS (ONE CENTERED EACH LONG WALL) WITH ONE 7 1/2" CABLE RACK HOOK PER CABLE RACK.
8. ALL COVERS MUST BE COMPLETE WITH A MOLDED LOGO (SEE LOGO DETAIL), MANUFACTURERS NAME AND TIER RATING LOGO (NO GLUE IN LOGOS). LOGO SHALL READ "CITY OF ARCADIA COMMUNICATIONS" UNLESS STATED OTHERWISE BY THE CITY OF ARCADIA.

TYPE 2 ITS VAULT & COVER

CITY OF ARCADIA
DEVELOPMENT SERVICES DEPT. - ENGINEERING DIV.

Phil W.
CITY ENGINEER

38971

RCE

DATE: 3/28/12

SCALE: NONE

DRAWN BY: -

STANDARD DRAWING

805-4

SHEET 1 OF 1