



FIRE ALARM COMMUNICATOR REPLACEMENT STANDARD

Arcadia Fire Prevention Bureau
710 S Santa Anita Ave, Arcadia, CA 91006
Phone (626) 574-5104
fireprevention@arcadiaca.gov

All replacements of fire alarm system communicators shall require a construction permit per the California Fire Code 901.3. Cellular communicators shall be accepted as means of multiple paths of communication. An additional VOIP or POTS phone line will not be required.

PLAN SUBMITTAL REQUIREMENTS

The plans must contain:


- **A layout of the building indicating the location of the fire alarm control panel and new communicator (see sample plan for reference). The drawing does not have to be to scale.**
- **Manufacturer's specification sheets for the new communicator (cut sheets).**

The Building Services Division will only accept an online submittal for plan review. Visit www.arcadiaca.gov/EDGE for details. You may also contact (626) 574-5416 for any questions regarding the plan submittal process.

INSPECTION

Upon approval of the plans, a permit will be issued by the Arcadia Building Division. Contact the Fire Prevention Bureau at (626) 574-5104 or fireprevention@arcadiaca.gov to set up a field inspection.

SYMBOL	MANUFACTURER	DESCRIPTION	MODEL NUMBER	CSFM NO.	QTY.
FACP ^E	Honeywell	EXISTING Fire Alarm Control Panel	Vista-32FB	EXISTING	1
FAC ^N	Telguard	Cellular Communicator	TG-7FS	7300-1402:0504	1
S ^E P	EXISTING	EXISTING Smoke Detector	EXISTING	EXISTING	1

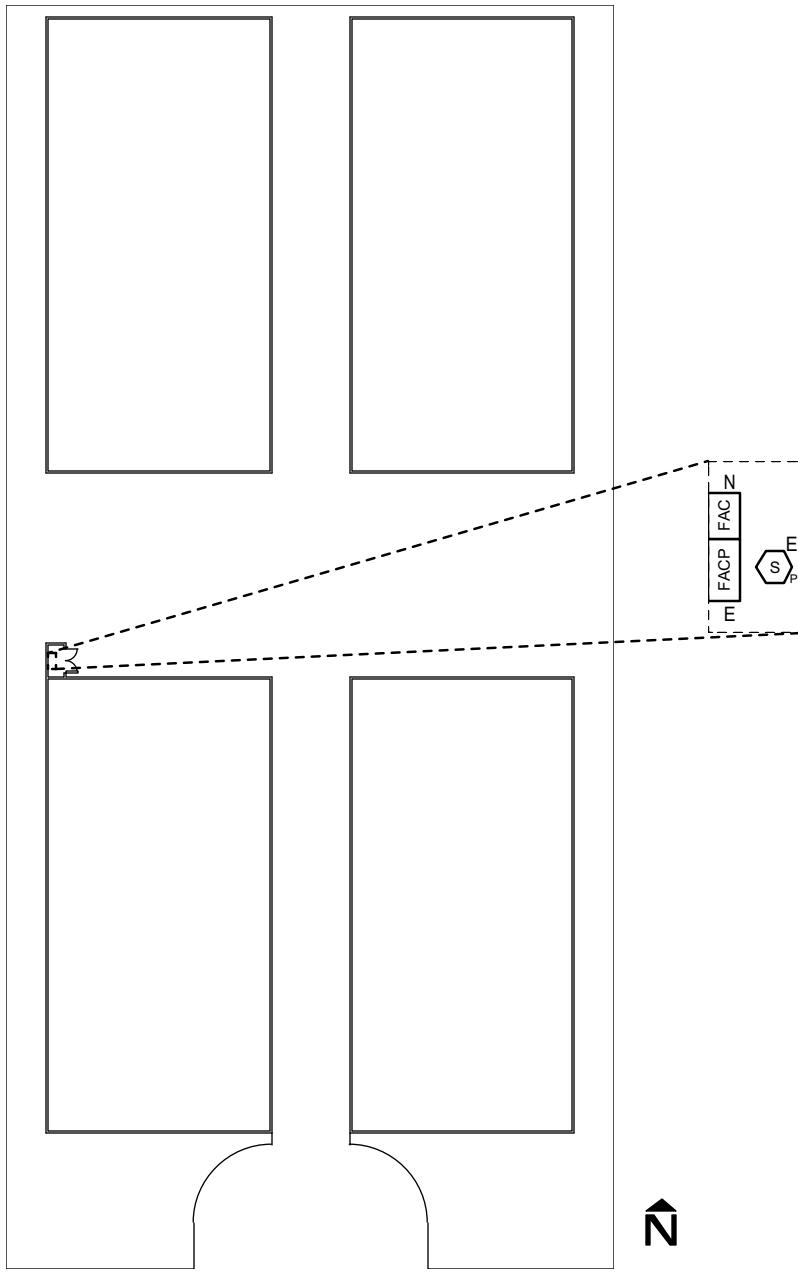

Rev. No.	Revision Name	Revision Date

Licensed Fire Alarm Company

State Contractors License C-10 #

SHEET TITLE:

CELLULAR
COMMUNICATOR
REPLACEMENT

SHEET 1 of 1